


TOP VIEW

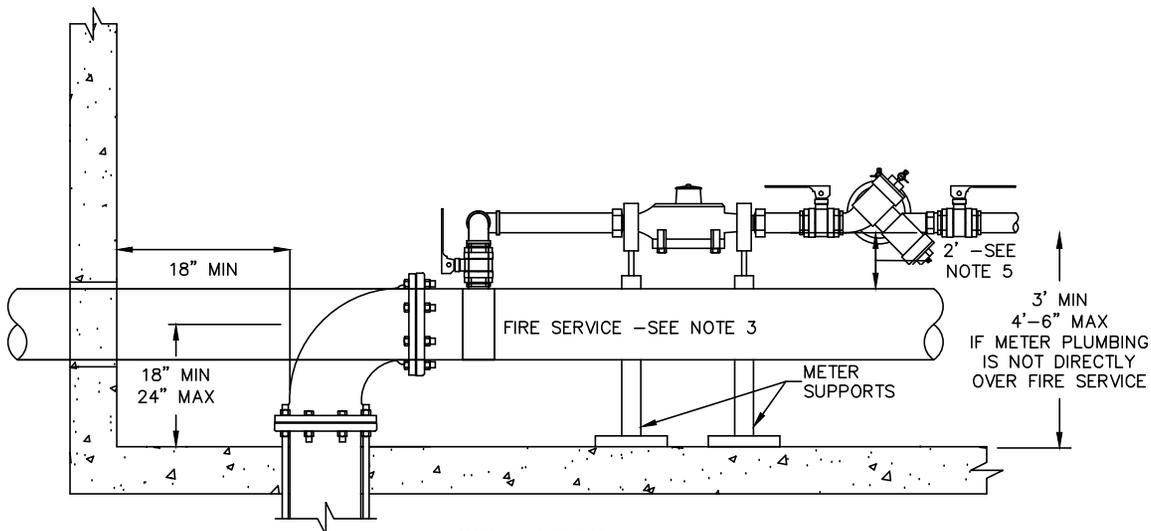

SIDE VIEW

NOTES:

1. ALL MATERIALS AND INSTALLATION PROCEDURES WILL CONFORM TO HWWC₀ TECHNICAL SPECIFICATIONS.
2. PRV WHEN NECESSARY WILL BE INSTALLED AND PURCHASED BY OWNER OR CONTRACTOR. PRV SHALL BE INSTALLED PRIOR TO METER.
3. TESTABLE DOUBLE CHECK BACK FLOW PREVENTOR REQUIRED ON ALL FIRE SERVICES.
4. ANY ELECTRICAL PANEL MUST MAINTAIN A 6' MINIMUM RADIUS FROM METER AND BACK FLOW.
5. METER PLUMBING MAY BE INSTALLED DIRECTLY OVER THE FIRE SERVICE PROVIDED THAT 2' CLEARANCE IS MAINTAINED. 4' MINIMUM CLEARANCE FROM ANY OBSTRUCTION IS MAINTAINED AND METER IS PROPERLY SUPPORTED.
6. WATTS SERIES 909 RPZ BACK FLOW PREVENTOR OR APPROVED EQUAL REQUIRED ON ALL DOMESTIC SERVICES. PROVIDE APPROPRIATE DRAIN PER MANUFACTURERS RECOMMENDATIONS.
7. PRESSURE REDUCERS ARE RECOMMENDED WHERE PRESSURE EXCEED 80 PSI. WHERE REQUIRED PRESSURE REDUCERS SHALL BE INSTALLED PRIOR TO WATER METER.



DETAIL W-2
**COMBINED FIRE AND DOMESTIC
 SERVICE ENTRANCE DETAIL**
 TOWN OF HANOVER WATER DEPT.
 REV: 0914 BY :PEK SCALE: NTS